



Tel:
Fax:

Page 1 of 12 Pages

Report No.: 12寸

Test Time: 2021-01-06 14:03

Luminaire Property

Luminaire Manufacturer:
Lamp Catalog: LED
Voltage: 120.0 V
Power: 19.62 W

Lamp Description: LED
Current: 0.166 A
Power Factor: 0.985

Photometric Results


CIE Class: Direct
Measurement Flux: 1829.5 lm
Downward Ratio: 99%
Field Angle: H156.5 V156.6
Luminaire Efficacy Rating (LER): 93
Max. Intensity: 662.34 cd

Total Rated Lamp Lumens: 1829.5 lm
Efficiency: 100%
Upward Ratio: 1%
Beam Angle: H109.3 V109.5
Central Intensity: 662.33 cd
Pos of Max. Intensity: H0 V0

Picture Of Luminaire



Luminous Intensity Distribution Curve

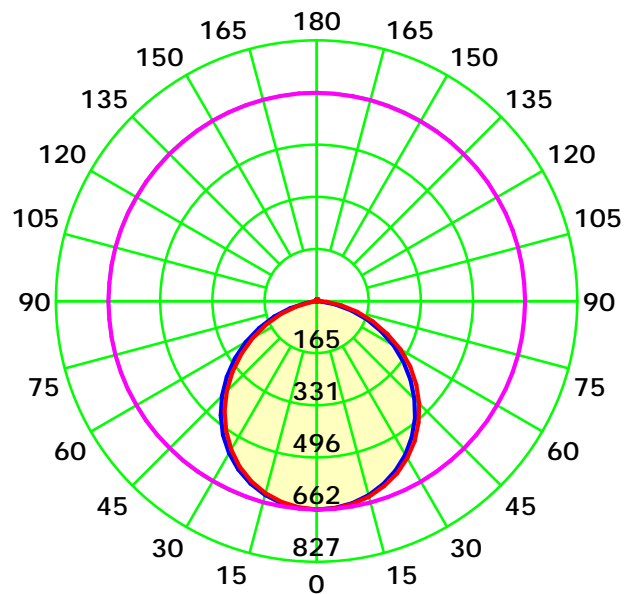

Average Diffuse Angle(50%): 109.4° Unit: cd

— C0-C180 — C90-C270 — G0

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:



Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:

Page 2 of 12 Pages

Luminous Intensity Distribution Curve

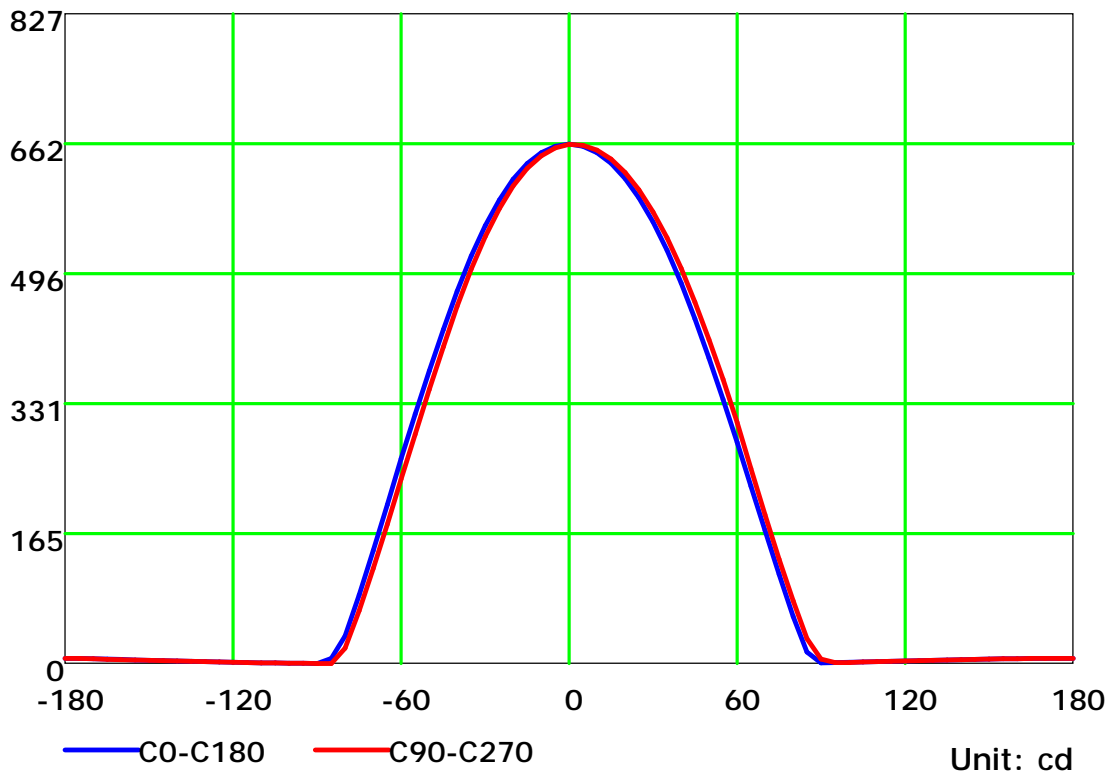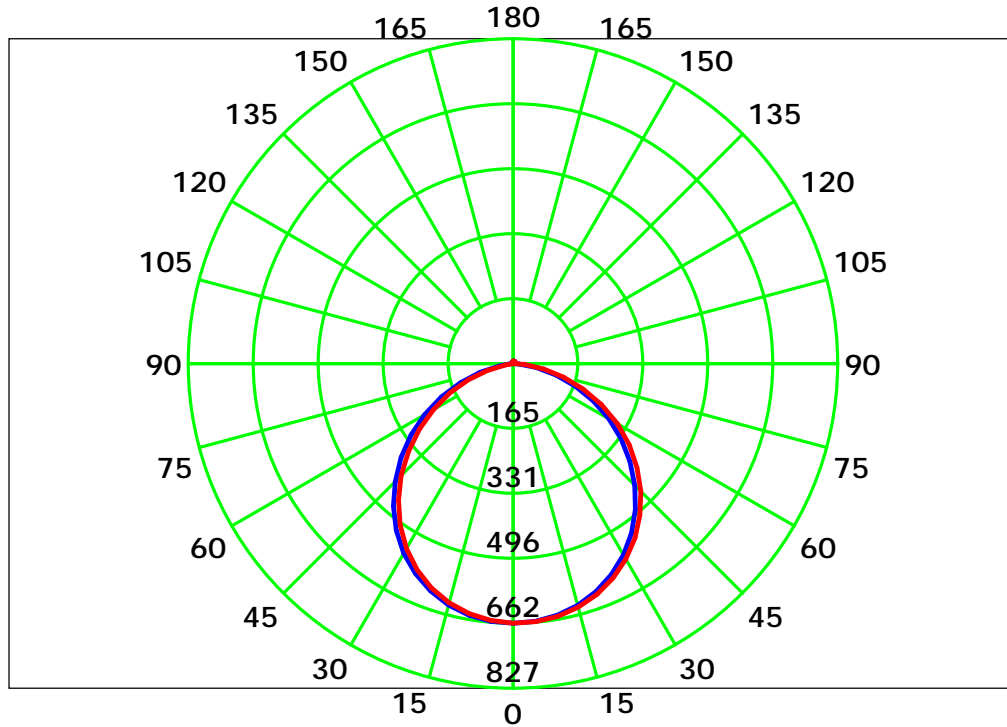

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:


Coefficients Of Utilization - Zonal Cavity Method

| | | | | | | | | | | | | | | | | | | |
|-----|----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|
| RC | 0.8 | 0.8 | 0.8 | 0.8 | 0.7 | 0.7 | 0.7 | 0.7 | 0.5 | 0.5 | 0.5 | 0.3 | 0.3 | 0.3 | 0.1 | 0.1 | 0.1 | 0 |
| RW | 0.7 | 0.5 | 0.3 | 0.1 | 0.7 | 0.5 | 0.3 | 0.1 | 0.5 | 0.3 | 0.1 | 0.5 | 0.3 | 0.1 | 0.5 | 0.3 | 0.1 | 0 |
| RCR | RF = 0.2 | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 101 | 101 | 101 | 99 |
| 1 | 109 | 104 | 100 | 97 | 106 | 102 | 98 | 95 | 98 | 95 | 92 | 94 | 91 | 89 | 90 | 88 | 86 | 84 |
| 2 | 99 | 91 | 85 | 79 | 97 | 89 | 83 | 78 | 86 | 80 | 76 | 82 | 78 | 74 | 79 | 75 | 72 | 70 |
| 3 | 91 | 80 | 72 | 66 | 88 | 79 | 71 | 65 | 75 | 69 | 64 | 73 | 67 | 63 | 70 | 65 | 62 | 59 |
| 4 | 83 | 71 | 63 | 56 | 81 | 70 | 62 | 55 | 67 | 60 | 55 | 65 | 59 | 54 | 62 | 57 | 53 | 51 |
| 5 | 76 | 64 | 55 | 48 | 74 | 62 | 54 | 48 | 60 | 53 | 47 | 58 | 52 | 47 | 56 | 51 | 46 | 44 |
| 6 | 71 | 57 | 48 | 42 | 69 | 56 | 48 | 42 | 54 | 47 | 41 | 53 | 46 | 41 | 51 | 45 | 41 | 39 |
| 7 | 65 | 52 | 43 | 37 | 64 | 51 | 43 | 37 | 50 | 42 | 37 | 48 | 41 | 36 | 47 | 41 | 36 | 34 |
| 8 | 61 | 47 | 39 | 33 | 59 | 47 | 39 | 33 | 45 | 38 | 33 | 44 | 37 | 33 | 43 | 37 | 32 | 30 |
| 9 | 57 | 44 | 35 | 30 | 55 | 43 | 35 | 30 | 42 | 35 | 30 | 41 | 34 | 29 | 39 | 34 | 29 | 27 |
| 10 | 53 | 40 | 32 | 27 | 52 | 40 | 32 | 27 | 39 | 32 | 27 | 38 | 31 | 27 | 37 | 31 | 27 | 25 |

Spacing Criteria (0-180): 1.25

Spacing Criteria (90-270): 1.26

Spacing Criteria (Diagonal): 1.36

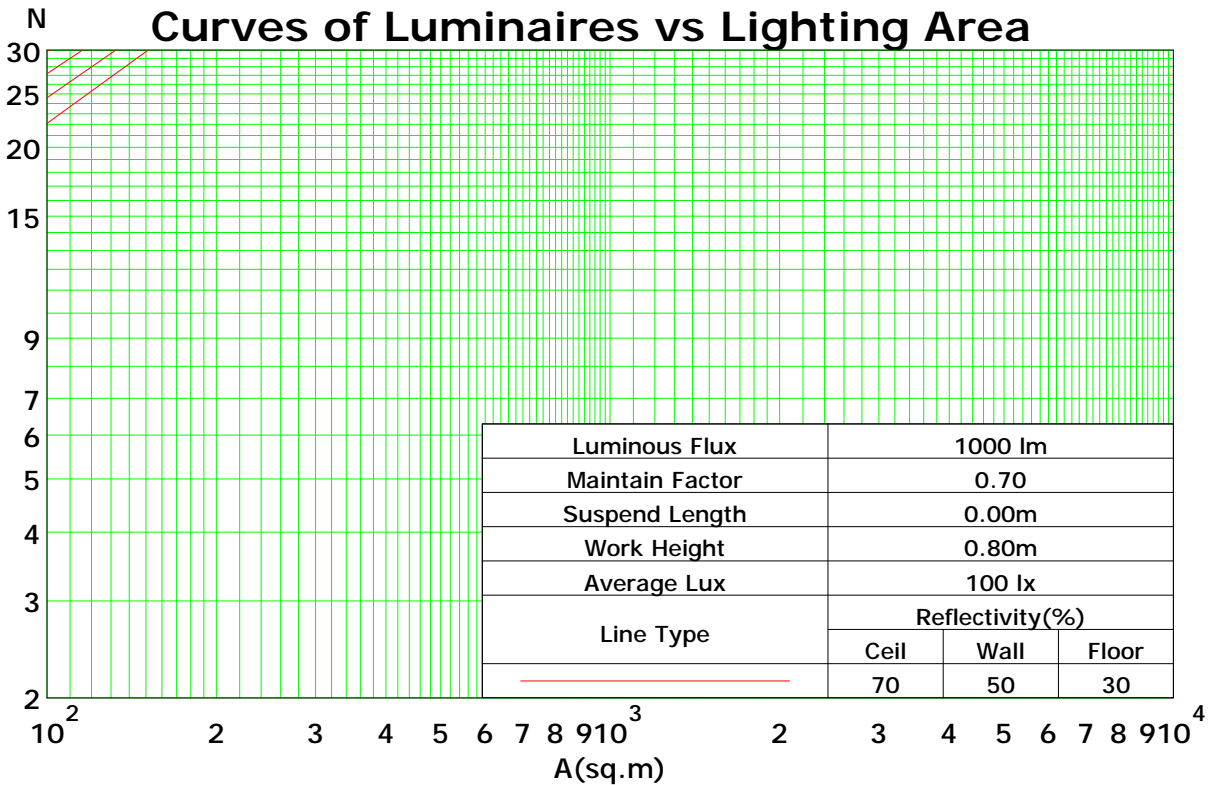

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 25°C

Operator:

Gamma Plane (°):0.0-180.0:5.0

Test Device: GPM-1600L

Distance: 6.361 m

Humidity: 56%


Inspector:



Tel:
Fax:

Page 4 of 12 Pages

IsoLux Plot

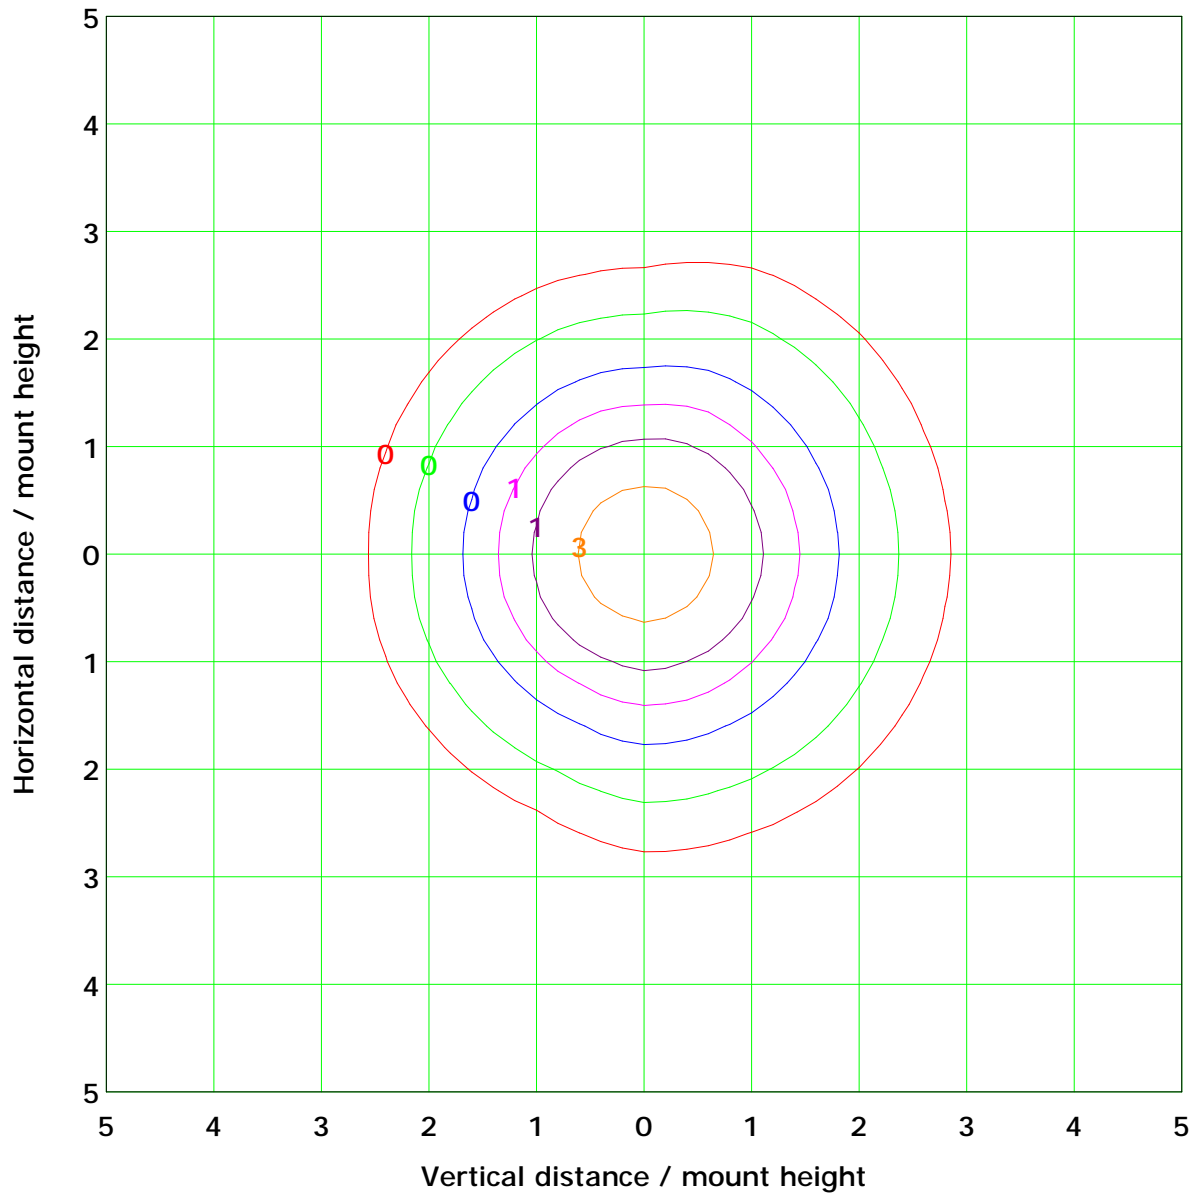

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:





Tel:
Fax:

Lum Limit Curve

| Dazzle | Quality | Illuminance (lx) | | | | | | | |
|--------|---------|------------------|------|------|-------|-------|-------|-------|-------|
| 1.15 | A | 2000 | 1000 | 500 | <=300 | | | | |
| 1.50 | B | | 2000 | 1000 | 500 | <=300 | | | |
| 1.85 | C | | | 2000 | 1000 | 500 | <=300 | | |
| 2.20 | D | | | | 2000 | 1000 | 500 | <=300 | |
| 2.55 | E | | | | | 2000 | 1000 | 500 | <=300 |

a b c d e f g h

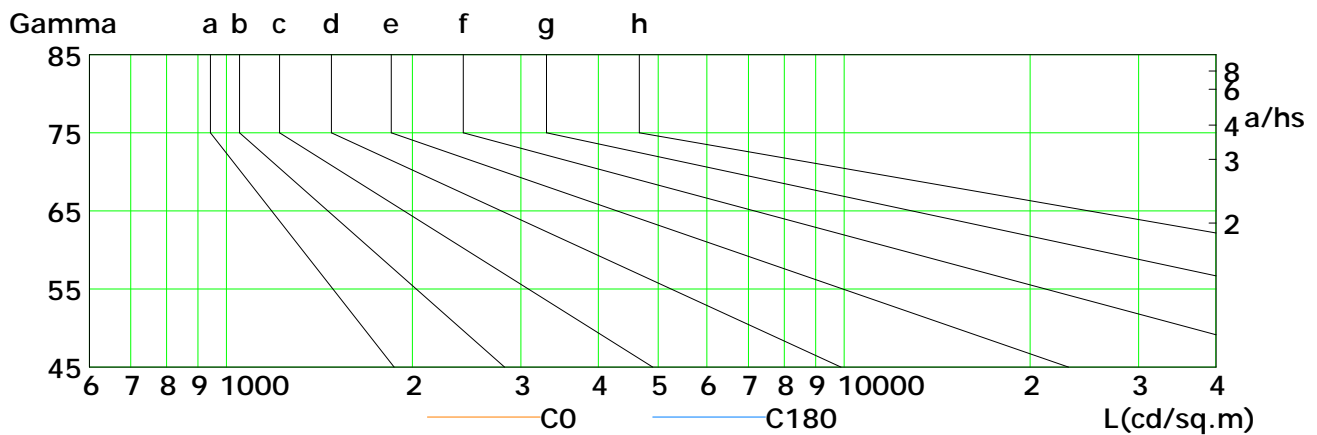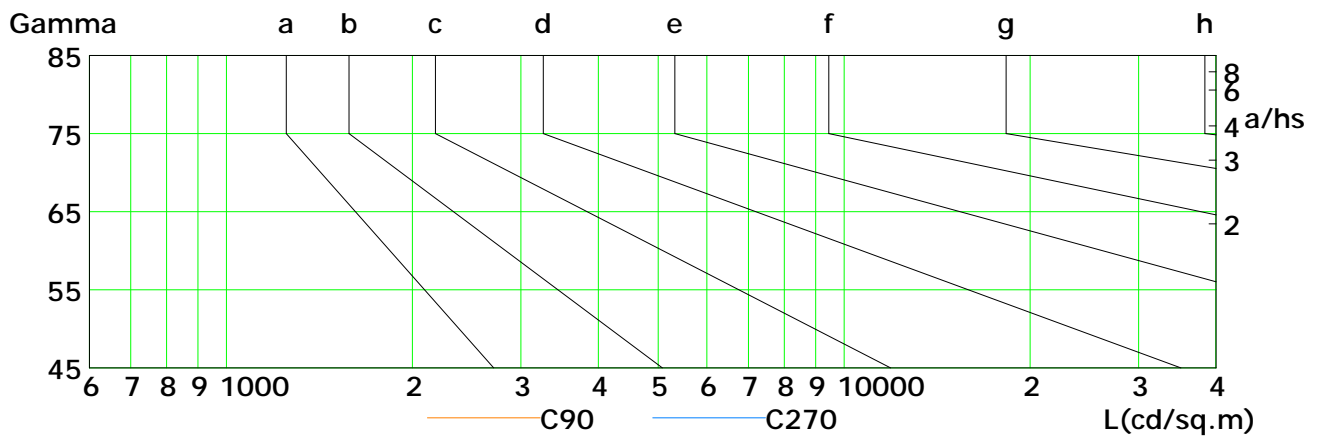

| L(cd/sq.m) | G45 | G50 | G55 | G60 | G65 | G70 | G75 | G80 | G85 |
|------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| C0 | 439 | 389 | 337 | 282 | 226 | 170 | 114 | 60 | 15 |
| C90 | 460 | 413 | 362 | 307 | 249 | 190 | 133 | 80 | 32 |
| C180 | 426 | 373 | 318 | 261 | 202 | 144 | 88 | 35 | 7 |
| C270 | 404 | 349 | 292 | 235 | 178 | 121 | 67 | 20 | 0 |

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:


Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:

Page 6 of 12 Pages

Illuminance at a Distance

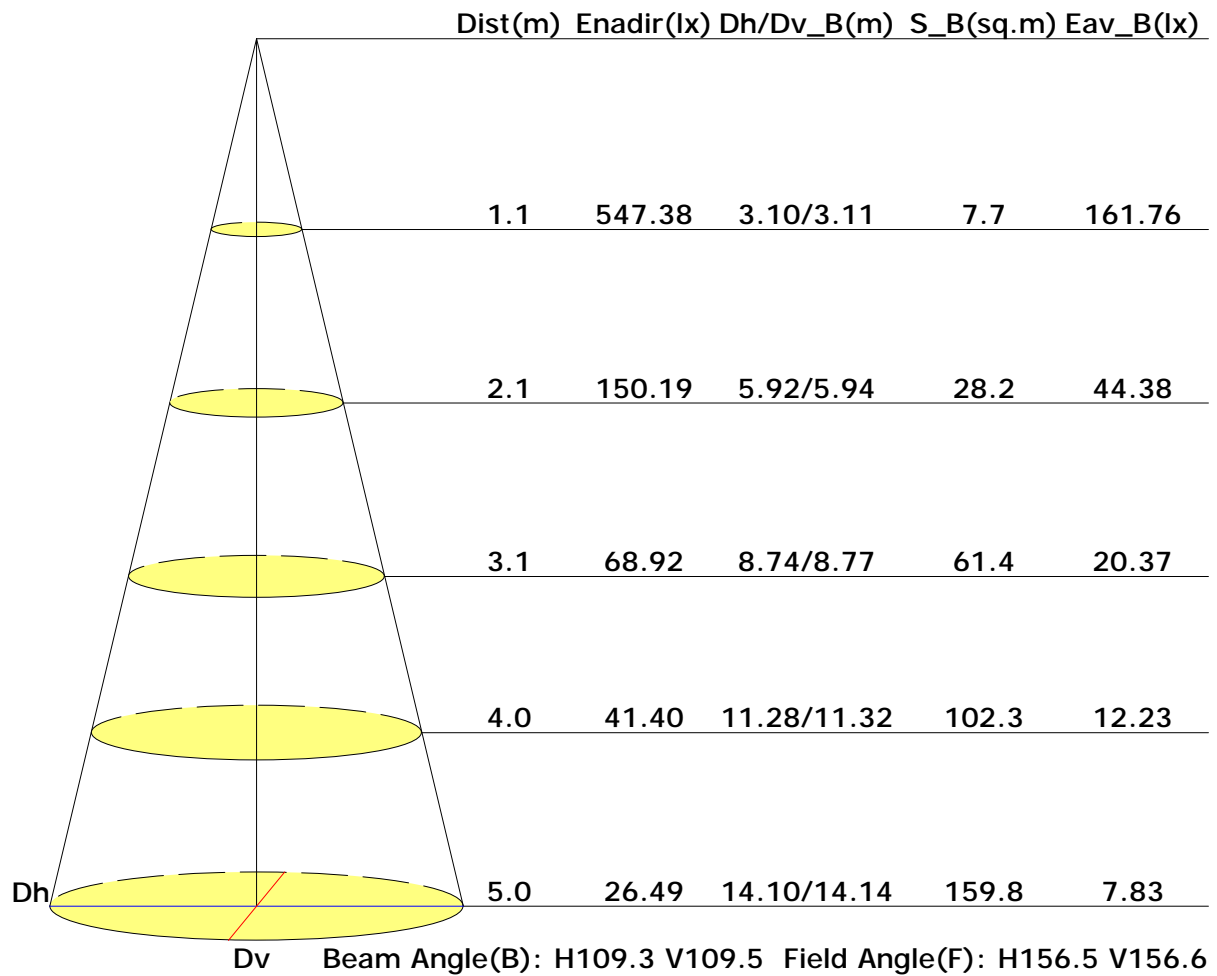

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:


Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:

Page 7 of 12 Pages

Vertical IsoLux Plot

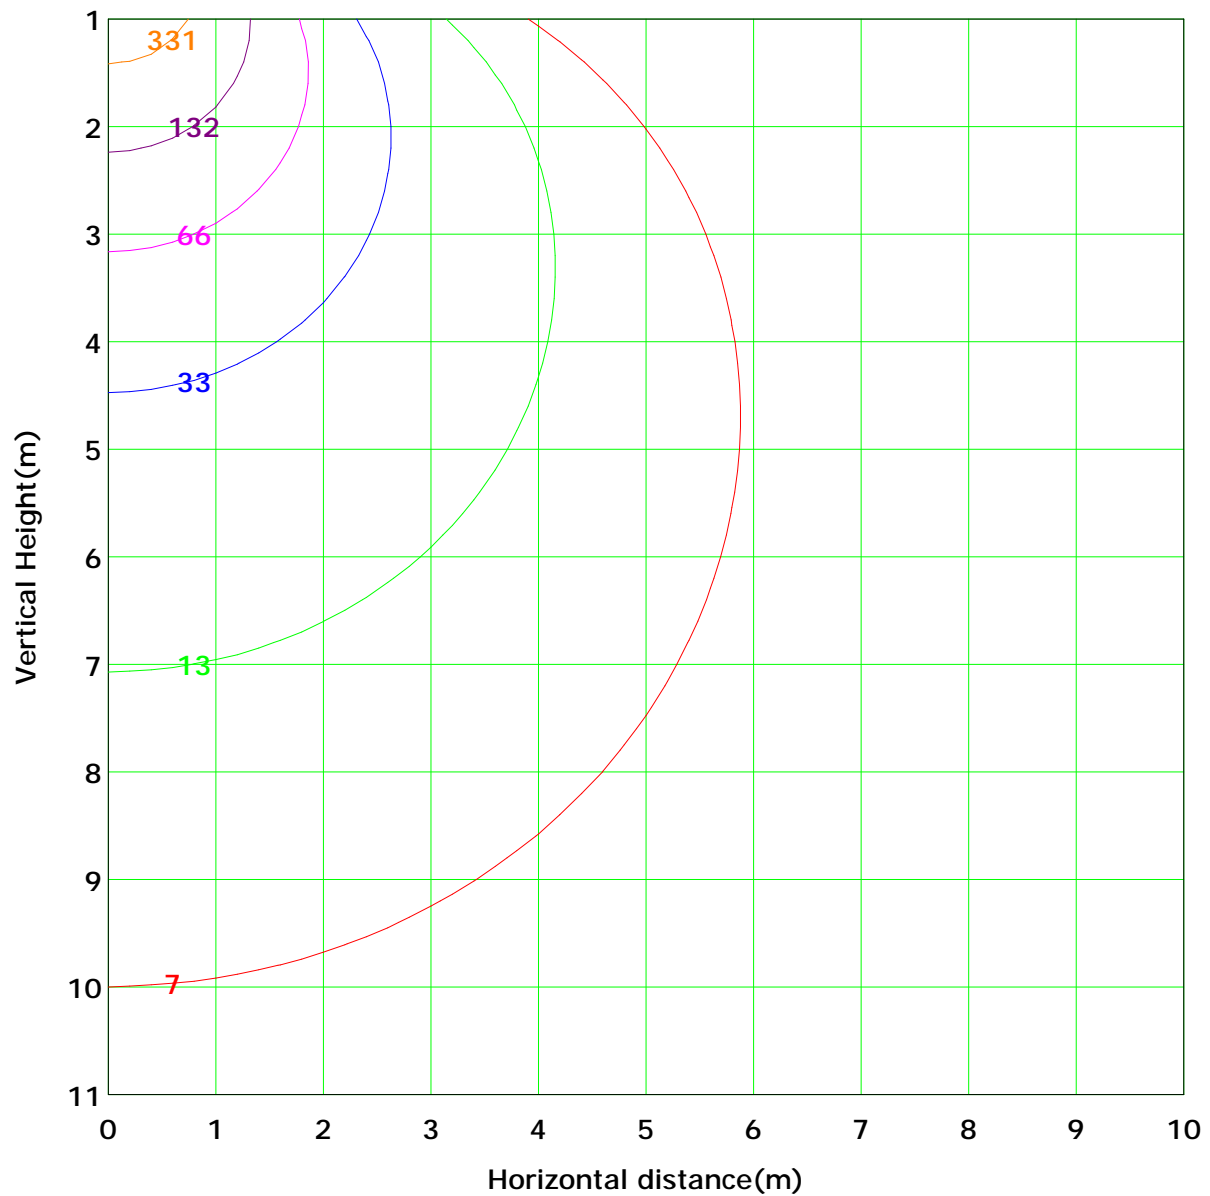

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 662.3 lx

| | |
|------------------|------------------|
| (1%): 6.6 lx | (2%): 13.2 lx |
| (5%): 33.1 lx | (10%): 66.2 lx |
| (20%): 132.5 lx | (50%): 331.2 lx |
| (100%): 662.3 lx | |

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:


Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:

Page 8 of 12 Pages

The Average Illuminance Effective Figure

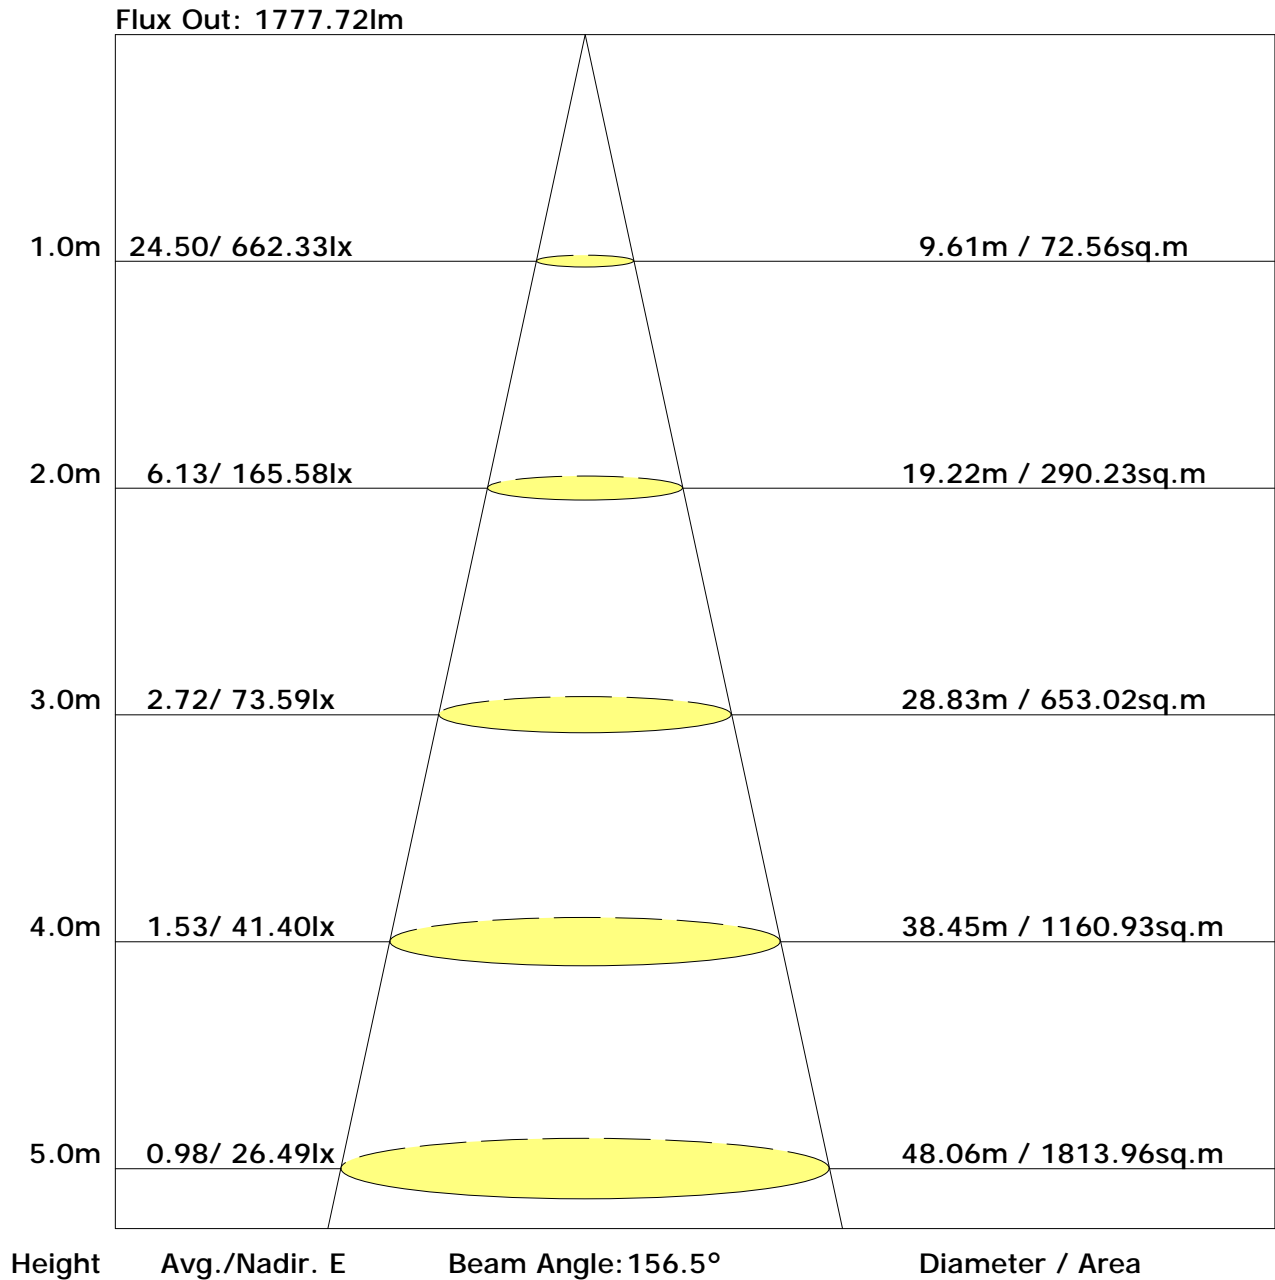


C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

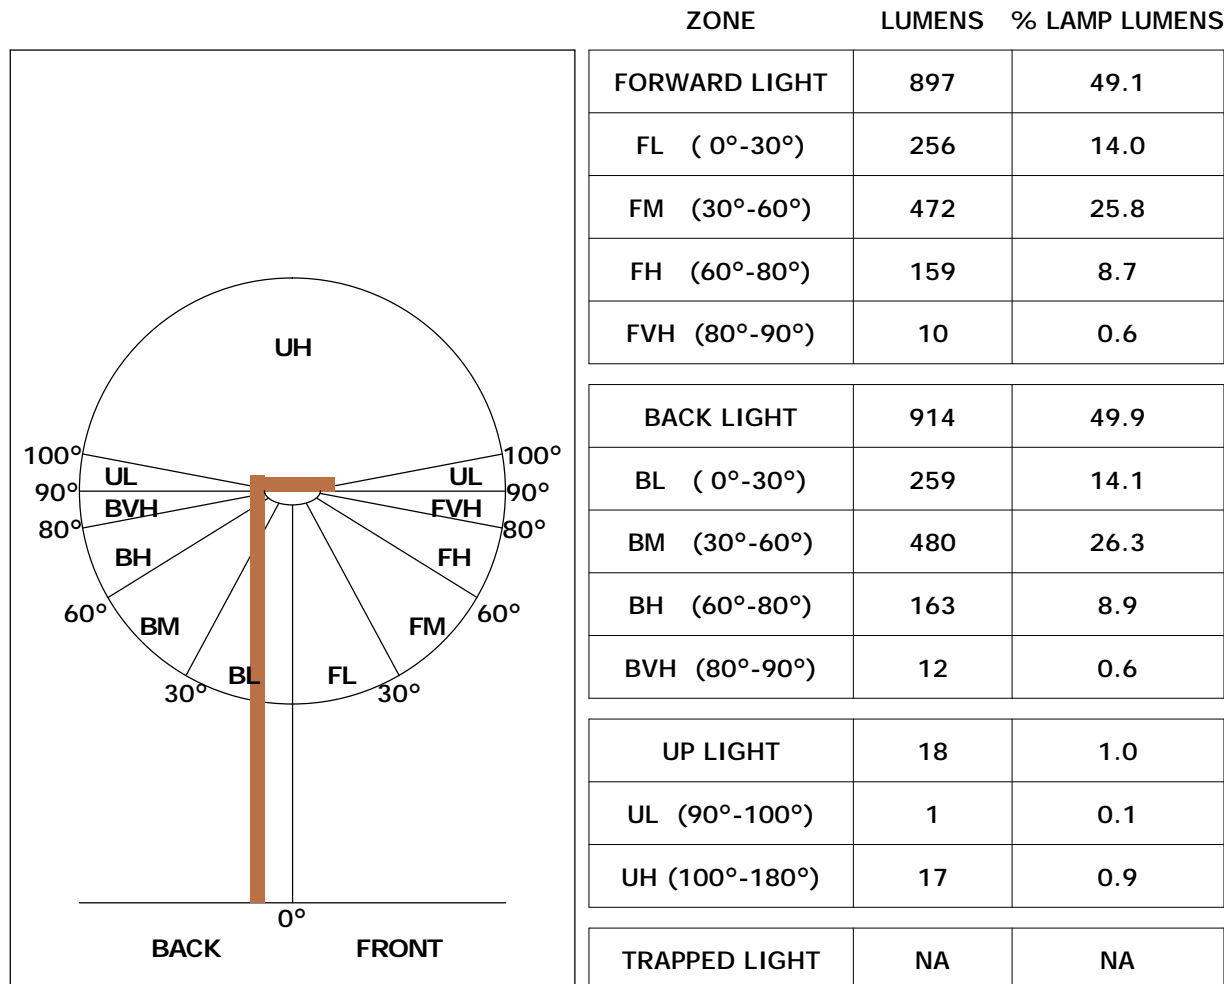

| BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07 | |
|--|----------|
| Asymmetrical Luminaire Types (Type I,II,III,IV) | B1 U2 G1 |
| Quadrilateral Symmetrical Luminaire Types (Type V,Area Light) | B1 U2 G1 |

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25℃
Operator:

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:
Fax:

Zonal Lumen

| Gamma [°] | I _{mean} [cd] | Zonal Flux [lm] | Sum Zonal Flux [lm] | Rel Zonal Flux [%] | Sum Rel Zonal Flux [%] |
|--------------|---------------------------|--------------------|------------------------|-----------------------|---------------------------|
| 0.0-5.0 | 660.0 | 15.8 | 15.8 | 0.86 | 0.86 |
| 5.0-10.0 | 654.6 | 46.8 | 62.6 | 2.56 | 3.42 |
| 10.0-15.0 | 643.6 | 76.4 | 139.0 | 4.17 | 7.60 |
| 15.0-20.0 | 626.9 | 103.3 | 242.3 | 5.65 | 13.24 |
| 20.0-25.0 | 604.3 | 126.8 | 369.1 | 6.93 | 20.17 |
| 25.0-30.0 | 575.7 | 145.7 | 514.8 | 7.96 | 28.14 |
| 30.0-35.0 | 541.2 | 159.4 | 674.2 | 8.71 | 36.85 |
| 35.0-40.0 | 501.0 | 167.2 | 841.3 | 9.14 | 45.99 |
| 40.0-45.0 | 455.8 | 168.8 | 1010.1 | 9.23 | 55.21 |
| 45.0-50.0 | 406.5 | 164.3 | 1174.4 | 8.98 | 64.19 |
| 50.0-55.0 | 354.0 | 154.0 | 1328.4 | 8.42 | 72.61 |
| 55.0-60.0 | 299.5 | 138.4 | 1466.8 | 7.57 | 80.18 |
| 60.0-65.0 | 243.3 | 118.3 | 1585.1 | 6.47 | 86.64 |
| 65.0-70.0 | 186.5 | 94.5 | 1679.6 | 5.16 | 91.81 |
| 70.0-75.0 | 130.5 | 68.2 | 1747.8 | 3.73 | 95.54 |
| 75.0-80.0 | 77.1 | 41.3 | 1789.1 | 2.25 | 97.79 |
| 80.0-85.0 | 32.5 | 17.7 | 1806.7 | 0.97 | 98.76 |
| 85.0-90.0 | 7.8 | 4.3 | 1811.0 | 0.23 | 98.99 |
| 90.0-95.0 | 1.5 | 0.8 | 1811.8 | 0.04 | 99.03 |
| 95.0-100.0 | 1.0 | 0.6 | 1812.4 | 0.03 | 99.06 |
| 100.0-105.0 | 1.3 | 0.7 | 1813.1 | 0.04 | 99.10 |
| 105.0-110.0 | 1.7 | 0.9 | 1813.9 | 0.05 | 99.15 |
| 110.0-115.0 | 2.0 | 1.0 | 1815.0 | 0.06 | 99.21 |
| 115.0-120.0 | 2.4 | 1.2 | 1816.1 | 0.06 | 99.27 |
| 120.0-125.0 | 2.8 | 1.3 | 1817.4 | 0.07 | 99.34 |
| 125.0-130.0 | 3.2 | 1.4 | 1818.8 | 0.08 | 99.41 |
| 130.0-135.0 | 3.6 | 1.4 | 1820.2 | 0.08 | 99.49 |
| 135.0-140.0 | 4.0 | 1.5 | 1821.7 | 0.08 | 99.57 |
| 140.0-145.0 | 4.4 | 1.5 | 1823.2 | 0.08 | 99.66 |
| 145.0-150.0 | 4.9 | 1.4 | 1824.6 | 0.08 | 99.73 |
| 150.0-155.0 | 5.3 | 1.3 | 1826.0 | 0.07 | 99.81 |
| 155.0-160.0 | 5.6 | 1.2 | 1827.1 | 0.06 | 99.87 |
| 160.0-165.0 | 6.0 | 1.0 | 1828.1 | 0.05 | 99.93 |
| 165.0-170.0 | 6.3 | 0.7 | 1828.9 | 0.04 | 99.97 |
| 170.0-175.0 | 6.5 | 0.5 | 1829.3 | 0.03 | 99.99 |
| 175.0-180.0 | 6.7 | 0.2 | 1829.5 | 0.01 | 100.00 |

C Plane (°):0.0-360.0: 22.5
Test Lab:
Test Type: TYPE C
Temperature: 25°C
Operator:

Gamma Plane (°):0.0-180.0:5.0
Test Device: GPM-1600L
Distance: 6.361 m
Humidity: 56%
Inspector:



Tel:

Fax:

Page 11 of 12 Pages

Candlepower Table

Unit: cd

| G\C | C0.0 | C22.5 | C45.0 | C67.5 | C90.0 | C112.5 | C135.0 | C157.5 | C180.0 | C202.5 |
|--------|-------|-------|-------|-------|-------|--------|--------|--------|--------|--------|
| G0.0 | 662.3 | 661.7 | 661.5 | 661.6 | 661.6 | 661.7 | 660.6 | 659.7 | 662.3 | 661.7 |
| G5.0 | 659.3 | 658.8 | 659.1 | 659.8 | 660.7 | 660.5 | 660.6 | 660.0 | 659.4 | 659.4 |
| G10.0 | 651.3 | 650.2 | 651.4 | 652.9 | 654.4 | 654.3 | 654.9 | 655.0 | 651.2 | 651.6 |
| G15.0 | 637.7 | 636.4 | 638.2 | 640.6 | 642.9 | 642.6 | 644.0 | 644.6 | 637.2 | 637.5 |
| G20.0 | 618.2 | 617.1 | 619.4 | 623.0 | 625.9 | 625.4 | 627.4 | 628.5 | 617.1 | 617.5 |
| G25.0 | 593.5 | 591.8 | 595.3 | 600.0 | 603.6 | 603.1 | 605.5 | 606.7 | 590.6 | 591.0 |
| G30.0 | 563.0 | 561.4 | 565.5 | 571.3 | 575.8 | 574.8 | 577.7 | 579.1 | 558.1 | 558.2 |
| G35.0 | 526.9 | 525.4 | 530.6 | 537.5 | 542.6 | 541.1 | 544.3 | 545.5 | 519.4 | 519.0 |
| G40.0 | 485.3 | 484.0 | 490.5 | 498.1 | 503.7 | 501.8 | 505.1 | 505.8 | 474.7 | 474.5 |
| G45.0 | 439.4 | 438.6 | 446.4 | 454.3 | 460.5 | 458.0 | 461.1 | 461.5 | 425.6 | 424.8 |
| G50.0 | 389.5 | 389.3 | 397.7 | 406.5 | 412.9 | 409.6 | 412.5 | 412.8 | 373.1 | 372.0 |
| G55.0 | 336.6 | 337.4 | 346.1 | 355.9 | 362.4 | 358.0 | 360.8 | 360.8 | 318.1 | 316.1 |
| G60.0 | 282.2 | 283.1 | 292.9 | 302.3 | 307.4 | 304.0 | 307.1 | 306.4 | 261.2 | 259.8 |
| G65.0 | 226.3 | 228.3 | 238.5 | 245.1 | 248.7 | 246.0 | 252.1 | 249.3 | 202.4 | 201.8 |
| G70.0 | 169.8 | 171.8 | 182.2 | 186.6 | 189.9 | 187.4 | 194.1 | 190.5 | 144.1 | 144.8 |
| G75.0 | 114.2 | 116.2 | 125.3 | 129.9 | 133.1 | 129.9 | 134.5 | 132.5 | 87.6 | 90.2 |
| G80.0 | 60.3 | 63.0 | 69.6 | 76.5 | 80.0 | 75.2 | 78.2 | 78.0 | 35.3 | 41.7 |
| G85.0 | 14.7 | 15.9 | 23.8 | 27.7 | 31.8 | 27.6 | 29.4 | 27.5 | 6.6 | 8.2 |
| G90.0 | 1.0 | 1.1 | 1.9 | 5.6 | 5.8 | 5.6 | 5.7 | 3.7 | 0.3 | 0.3 |
| G95.0 | 1.3 | 1.4 | 1.3 | 1.3 | 1.3 | 1.3 | 1.2 | 1.2 | 0.5 | 0.5 |
| G100.0 | 1.7 | 1.7 | 1.7 | 1.7 | 1.6 | 1.7 | 1.6 | 1.6 | 0.7 | 0.6 |
| G105.0 | 2.1 | 2.1 | 2.1 | 2.1 | 2.0 | 2.1 | 2.0 | 2.0 | 0.9 | 0.9 |
| G110.0 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.5 | 2.4 | 2.4 | 1.2 | 1.1 |
| G115.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 3.0 | 2.9 | 2.8 | 1.5 | 1.4 |
| G120.0 | 3.4 | 3.5 | 3.4 | 3.4 | 3.4 | 3.4 | 3.3 | 3.3 | 1.8 | 1.7 |
| G125.0 | 3.9 | 3.9 | 3.9 | 3.9 | 3.9 | 3.8 | 3.8 | 3.7 | 2.2 | 2.0 |
| G130.0 | 4.3 | 4.4 | 4.3 | 4.3 | 4.3 | 4.3 | 4.2 | 4.2 | 2.5 | 2.4 |
| G135.0 | 4.8 | 4.8 | 4.8 | 4.7 | 4.8 | 4.7 | 4.7 | 4.6 | 3.0 | 2.8 |
| G140.0 | 5.2 | 5.2 | 5.2 | 5.2 | 5.2 | 5.2 | 5.1 | 5.0 | 3.4 | 3.3 |
| G145.0 | 5.5 | 5.6 | 5.5 | 5.5 | 5.6 | 5.5 | 5.4 | 5.4 | 3.9 | 3.8 |
| G150.0 | 5.9 | 5.9 | 5.9 | 5.9 | 5.9 | 5.9 | 5.8 | 5.7 | 4.4 | 4.3 |
| G155.0 | 6.2 | 6.2 | 6.2 | 6.2 | 6.2 | 6.2 | 6.1 | 6.0 | 4.8 | 4.7 |
| G160.0 | 6.4 | 6.4 | 6.4 | 6.5 | 6.4 | 6.4 | 6.3 | 6.3 | 5.3 | 5.2 |
| G165.0 | 6.6 | 6.6 | 6.6 | 6.7 | 6.6 | 6.6 | 6.6 | 6.6 | 5.8 | 5.7 |
| G170.0 | 6.8 | 6.8 | 6.7 | 6.8 | 6.8 | 6.7 | 6.7 | 6.7 | 6.2 | 6.1 |
| G175.0 | 6.9 | 6.8 | 6.8 | 6.8 | 6.8 | 6.7 | 6.8 | 6.8 | 6.6 | 6.4 |
| G180.0 | 6.9 | 6.7 | 6.7 | 6.7 | 6.7 | 6.7 | 6.7 | 6.7 | 6.9 | 6.7 |

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 25°C

Operator:

Gamma Plane (°):0.0-180.0:5.0

Test Device: GPM-1600L

Distance: 6.361 m

Humidity: 56%

Inspector:



Tel:

Fax:

Page 12 of 12 Pages

Candlepower Table (Continue 1)

Unit: cd

| G\C | C225.0 | C247.5 | C270.0 | C292.5 | C315.0 | C337.5 | C360.0 | | | |
|--------|--------|--------|--------|--------|--------|--------|--------|--|--|--|
| G0.0 | 661.5 | 661.6 | 661.6 | 661.7 | 660.6 | 659.7 | 662.3 | | | |
| G5.0 | 658.7 | 657.9 | 657.1 | 657.2 | 655.8 | 654.0 | 659.3 | | | |
| G10.0 | 650.2 | 648.3 | 647.1 | 647.5 | 645.3 | 643.0 | 651.3 | | | |
| G15.0 | 635.3 | 633.2 | 631.2 | 631.7 | 628.8 | 626.0 | 637.7 | | | |
| G20.0 | 614.5 | 611.2 | 608.7 | 609.7 | 606.1 | 603.0 | 618.2 | | | |
| G25.0 | 587.4 | 582.7 | 579.8 | 581.1 | 577.3 | 574.1 | 593.5 | | | |
| G30.0 | 553.6 | 548.3 | 544.4 | 546.3 | 542.2 | 539.2 | 563.0 | | | |
| G35.0 | 513.2 | 506.9 | 502.8 | 505.4 | 501.3 | 498.4 | 526.9 | | | |
| G40.0 | 467.4 | 460.3 | 455.4 | 458.9 | 454.7 | 452.4 | 485.3 | | | |
| G45.0 | 416.9 | 408.5 | 403.8 | 407.8 | 404.1 | 402.3 | 439.4 | | | |
| G50.0 | 363.1 | 354.7 | 349.2 | 353.4 | 350.4 | 349.1 | 389.5 | | | |
| G55.0 | 306.5 | 297.6 | 292.0 | 297.2 | 294.5 | 294.0 | 336.6 | | | |
| G60.0 | 249.9 | 240.1 | 234.9 | 240.4 | 238.4 | 238.5 | 282.2 | | | |
| G65.0 | 192.2 | 182.9 | 177.5 | 183.0 | 181.5 | 182.5 | 226.3 | | | |
| G70.0 | 137.3 | 127.4 | 121.3 | 128.1 | 127.6 | 127.8 | 169.8 | | | |
| G75.0 | 85.2 | 73.6 | 67.4 | 73.9 | 76.4 | 74.7 | 114.2 | | | |
| G80.0 | 37.9 | 24.6 | 19.8 | 24.8 | 29.2 | 28.3 | 60.3 | | | |
| G85.0 | 2.6 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 14.7 | | | |
| G90.0 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 0.3 | 1.0 | | | |
| G95.0 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 1.3 | | | |
| G100.0 | 0.6 | 0.7 | 0.7 | 0.7 | 0.7 | 0.7 | 1.7 | | | |
| G105.0 | 0.9 | 0.9 | 0.9 | 0.9 | 0.9 | 1.0 | 2.1 | | | |
| G110.0 | 1.1 | 1.1 | 1.2 | 1.1 | 1.2 | 1.2 | 2.5 | | | |
| G115.0 | 1.4 | 1.4 | 1.5 | 1.4 | 1.5 | 1.5 | 3.0 | | | |
| G120.0 | 1.7 | 1.7 | 1.8 | 1.7 | 1.8 | 1.8 | 3.4 | | | |
| G125.0 | 2.0 | 2.1 | 2.2 | 2.1 | 2.1 | 2.2 | 3.9 | | | |
| G130.0 | 2.4 | 2.4 | 2.5 | 2.4 | 2.5 | 2.6 | 4.3 | | | |
| G135.0 | 2.8 | 2.8 | 2.9 | 2.8 | 2.9 | 3.0 | 4.8 | | | |
| G140.0 | 3.2 | 3.3 | 3.3 | 3.3 | 3.3 | 3.4 | 5.2 | | | |
| G145.0 | 3.7 | 3.7 | 3.8 | 3.7 | 3.8 | 3.9 | 5.5 | | | |
| G150.0 | 4.2 | 4.2 | 4.3 | 4.2 | 4.3 | 4.4 | 5.9 | | | |
| G155.0 | 4.7 | 4.7 | 4.7 | 4.7 | 4.8 | 4.8 | 6.2 | | | |
| G160.0 | 5.1 | 5.2 | 5.2 | 5.2 | 5.2 | 5.3 | 6.4 | | | |
| G165.0 | 5.6 | 5.6 | 5.7 | 5.6 | 5.7 | 5.7 | 6.6 | | | |
| G170.0 | 6.0 | 6.0 | 6.1 | 6.1 | 6.1 | 6.2 | 6.8 | | | |
| G175.0 | 6.4 | 6.4 | 6.5 | 6.5 | 6.5 | 6.6 | 6.9 | | | |
| G180.0 | 6.7 | 6.7 | 6.7 | 6.7 | 6.7 | 6.7 | 6.9 | | | |

C Plane (°):0.0-360.0: 22.5

Test Lab:

Test Type: TYPE C

Temperature: 25℃

Operator:

Gamma Plane (°):0.0-180.0:5.0

Test Device: GPM-1600L

Distance: 6.361 m

Humidity: 56%

Inspector: